
Unilateral Hearing Loss (UHL)

Ensuring success for every child right from the start







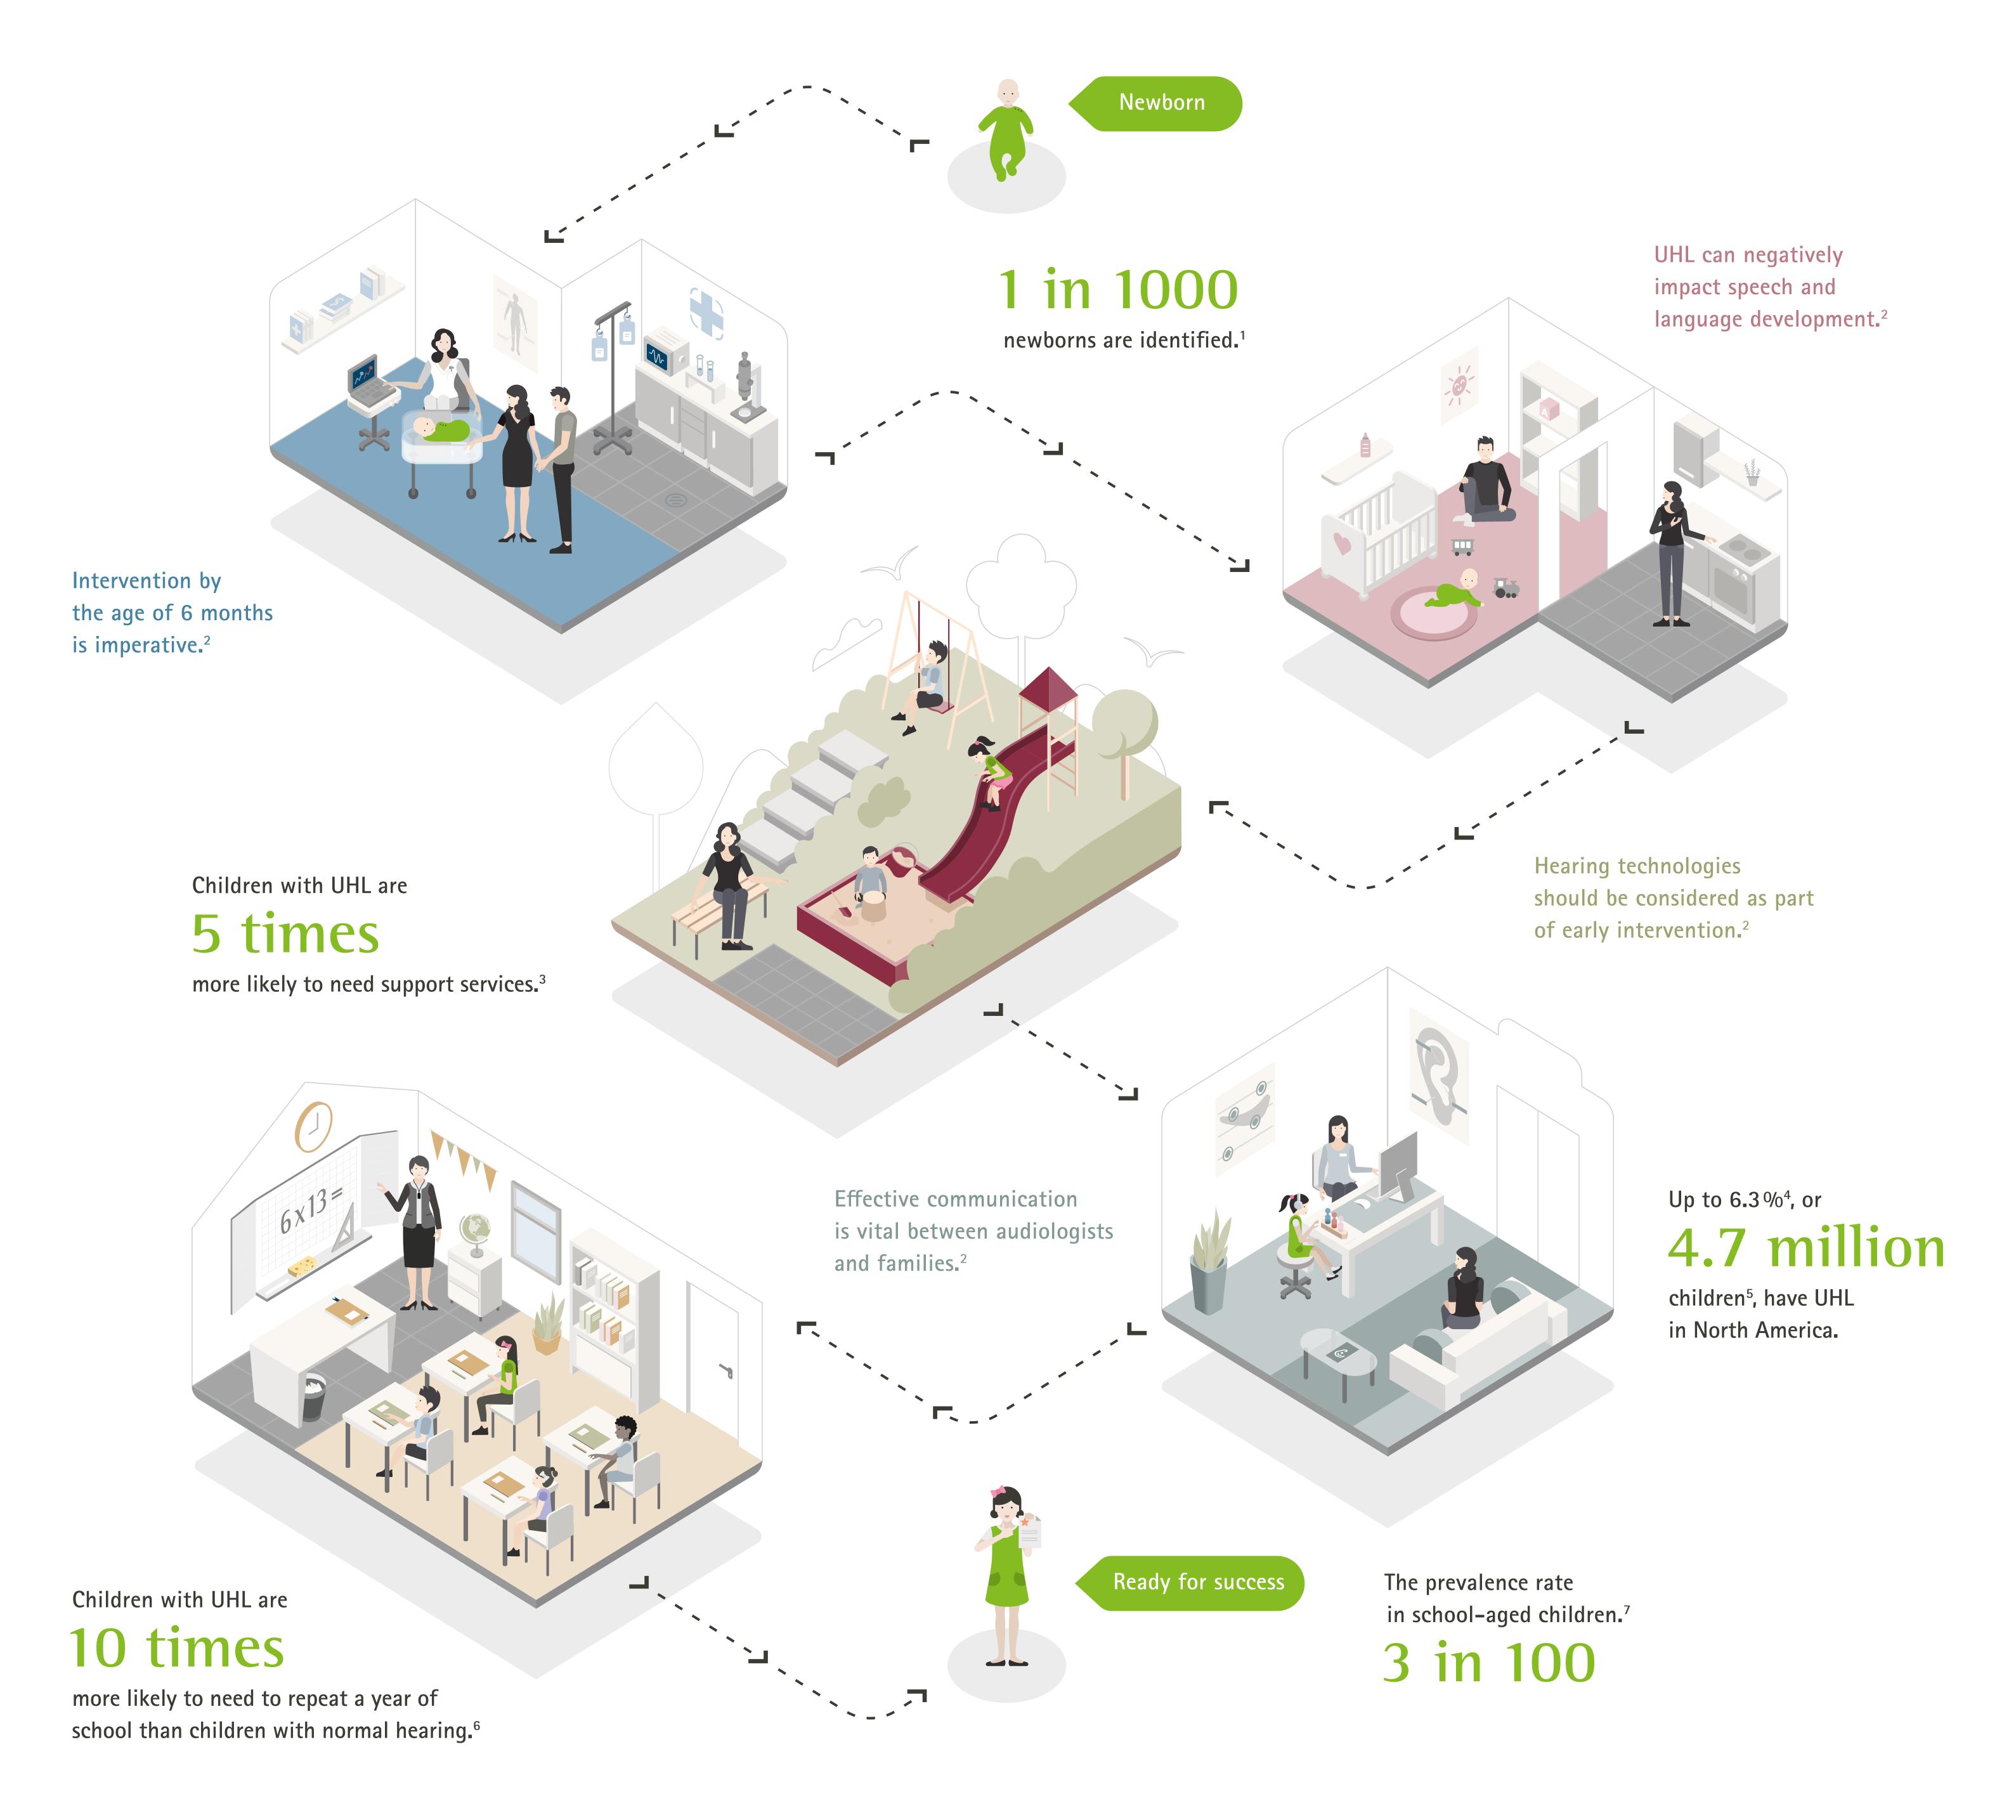

Fit CROS B system with Phonak Sky™ B



Fit normal hearing ear with Roger™ Focus receiver



Use Roger for all solutions incl. BCHA and Cl

phonakpro.com/uhl

1 Prieve, B., Dalzell, L., Berg, A., Bradley, M., Cacace, A., Campbell, D., DeCristofaro, J., Greenberg, E., Gross, S., Orlando, M., Pinheiro, J., Regan, J., Spivak, L., & Stevens, F. (2000). The New York State universal newborn hearing screening demonstration project: Outpatient outcome measures. Ear and Hearing, 21 (2), 104–117. 2 Bagatto, M., DesGeorges, J., King, A., Kitterick, P., Laurnagaray, D., Lewis, S.,...Tharpe, A.M. (2018). Quick Practice Guideline - Tools and considerations for assessing and managing unilateral hearing loss in children. Retrieved from www.phonakpro.com/evidence, accessed May 23rd, 2018. 3 Oyler, R.F., Oyler, A.L., & Matkin, N.D. (1988). Unilateral hearing loss: demographics and educational impact. Language, Speech, and Hearing Services in Schools, 19, 201–210. 4 Ross, D.S., Visser, S.N., Holstrum, W.J., Qin, T, & Kenneson, A. (2010). Highly variable population-based prevalence rates of unilateral hearing loss after the application of common case definitions. Ear and Hearing. 31(1): 126–133. 5 Central Intelligence Agency. (2017). The World Factbook. https://www.cia.gov/library/publications/the-world-factbook/geos/ch.html, accessed May 23rd, 2018. 6 Bess, F.H. & Tharpe, A.M. (1986). Case history data on unilaterally hearing-impaired children. Ear and Hearing, 7, 14–19. 7 Bess, F.H., Dodd-Murphy, J. & Parker, R.A. (1998). Children with minimal sensorineural hearing loss: Prevalence, educational performance, and functional status. Ear and Hearing, 9, 339–354.



041-2011-02/V1.00/2018-06 © 2018 Sonova AG All rights reserved